


IN1129 PUMP INTERRUPTER

Notes:

1. Make sure all connections are tight.
2. 10730 Control must be in mode two, this is indicated by the repeating double blue flash after control has fully booted up.

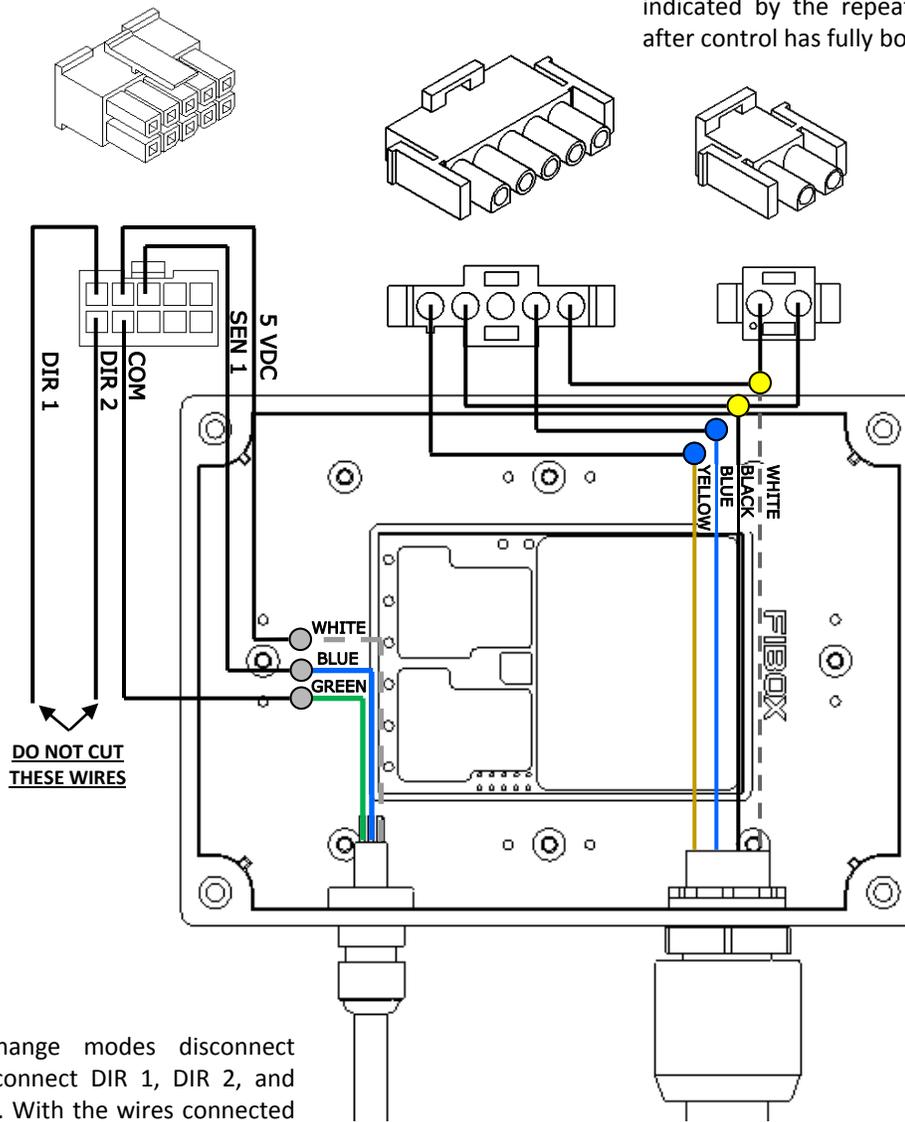

NOTE: To change modes disconnect power, then connect DIR 1, DIR 2, and COM together. With the wires connected reconnect power. Once the LED flashes blue disconnect the wires. This will cycle through the modes.